

# FUNDERMAX GMBH TEST REPORT

**SCOPE OF WORK**

SEFA 8PH-2014, 8.1 Analysis of Max Compact Interior White and Black Plaques

**REPORT NUMBER**

103600635GRR-001c

**ISSUE DATE**

25-September-2018

**PAGES**

18

**DOCUMENT CONTROL NUMBER**

Per GFT-OP-10 (6-March-2018)

© 2018 INTERTEK



## TEST REPORT FOR FUNDERMAX GMBH

Report No.: 103600635GRR-001c

Date: 25-September-2018

P.O.: 4500167024

Telephone: +1 616 656 7401

Facsimile: +1 616 656 2022

[www.intertek.com](http://www.intertek.com)

### SECTION 1

#### CLIENT INFORMATION

Attention: Erich Streit

FunderMax GmbH

IZ-NÖ-Süd Straße 3

2355 Wiener Neudorf

Österreich

Austria


Phone: +43 (0) 59494 4659

Email: [erich.streit@fundermax.biz](mailto:erich.streit@fundermax.biz)



---

**Marie Peck**  
**Test Engineer**



---

**Gary Liu**  
**Project Reviewer**

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

**SECTION 2**

**SUMMARY AND CONCLUSION**

Date Received: 28-August-2018  
Dates Tested: 12-September-2018 to 20-September-2018

**DESCRIPTION OF SAMPLES**

Part Description: Max Compact Interior Plaques  
Material Submitted: Four (4) Black Plaques & Four (4) White Plaques  
Material Specification: SEFA 8PH-2014 Section 8.1  
Condition of Samples: Production

**WORK REQUESTED/APPLICABLE DOCUMENTS**

SEFA 8PH-2014 Section 8.1

Intertek quote Qu-00893211

**CONCLUSION**

TEST	DISPOSITION
2.1 Chemical Resistance:	
Black Sample	*CONFORMING
White Sample	*CONFORMING

\* Suitability for a given application is dependent upon the chemicals used in a given laboratory.

**SAMPLE DISPOSITION**

After testing completed, samples were rendered unusable and then disposed of.

### SECTION 3

#### 2.1 CHEMICAL/STAIN RESISTANCES:

Date Received: 28-August-2018  
Dates Tested: 12-September-2018 to 20-September-2018  
Location: Intertek

#### DESCRIPTION OF SAMPLES:

Part Description: Max Compact Interior Plaques  
Material Submitted: Four (4) Black Plaques & Four (4) White Plaques  
Material Specification: SEFA 8PH-2014 Section 8.1  
Condition of Samples: Production

#### TEST PROCEDURE:

Test Method: Per SEFA 8PH-2014 Section 8.1  
The received sample to be tested for chemical resistance as described herein: Place panel on flat surface, clean with soap (Liqui-Nox at 5% concentration) and water and blot dry. Condition the panel for 48-hours at  $73\pm 3^{\circ}\text{F}$  ( $23\pm 2^{\circ}\text{C}$ ) and  $50 \pm 5\%$  relative humidity. Test the panel for chemical resistance using forty-nine (49) different chemical reagents by the following methods.

Method A: For volatile chemicals – Test volatile chemicals by placing a cotton ball saturated with reagent in the mouth of a 1-oz. (29.574cc) bottle and inverting the bottle on the surface of the panel.

Method B: For non-volatile chemicals – Test non-volatile chemicals by placing five drops of the reagent on the surface of the panel and covering with a 24mm watch glass, convex side down.

For both of the above methods, leave the reagents on the panel for a period of one hour. Wash off the panel with water, clean with detergent and naphtha, and rinse with deionized water. Dry with a towel and evaluate after 24-hours at  $73^{\circ} \pm 3^{\circ}\text{F}$  ( $23^{\circ} \pm 2^{\circ}\text{C}$ ) and  $50 \pm 5\%$  relative humidity, or the currently accepted guideline set by ASTM using the following rating system.

Rating Scale: **Level 0 - No detectable change.**  
**Level 1 - Slight change in color or gloss.**  
**Level 2 - Slight surface etching or severe staining.**  
**Level 3 - Pitting, cratering, swelling, or erosion of coating. Obvious and significant deterioration.**

Number of Samples: Two (2) Panel Types

**ACCEPTANCE CRITERIA:**

Per SEFA 8PH-2014 Section 8.1

Range of results is provided to establish the acceptable range for a Laboratory Grade Finish. Results will vary from manufacturer to manufacturer due to differences in finish formulations. Laboratory grade finishes shall result in no more than four (4) Level 3 conditions. Individual test results, for the specified 49 reagents, will be verified with the established third party, independent SEFA 8 test submittal form. Suitability for a given application is dependent upon the chemicals used in a given laboratory.

**RESULTS:**

**Table 3: Max Compact Interior Black Sample Chemical Spot Test Results**

TEST NO.	CHEMICAL (% BY VOL.)	METHOD	RATING	COMMENTS
1	Acetate, Amyl	A	0	
2	Acetate, Ethyl	A	0	
3	Acetic Acid, 98%	B	0	
4	Acetone	A	0	
5	Acid Dichromate, 5%	B	1	Slight gloss change
6	Alcohol, Butyl	A	0	
7	Alcohol, Ethyl	A	0	
8	Alcohol, Methyl	A	1	Slight gloss change
9	Ammonium Hydroxide, 28%	B	0	
10	Benzene	A	0	
11	Carbon Tetrachloride	A	0	
12	Chloroform	A	0	
13	Chromic Acid, 60%	B	0	
14	Cresol	A	0	
15	Dichloroacetic Acid	A	0	
16	Dimethylformamide	A	0	
17	Dioxane	A	0	
18	Ethyl Ether	A	0	
19	Formaldehyde, 37%	A	0	
20	Formic Acid, 90%	B	1	Slight gloss change
21	Furfural	A	1	Slight gloss change

**TEST REPORT FOR FUNDERMAX GMBH**

Date: 25-September-2018

Report No.: 103600635GRR-001c

P.O.: 4500167024

TEST NO.	CHEMICAL (% BY VOL.)	METHOD	RATING	COMMENTS
22	Gasoline	A	0	
23	Hydrochloric Acid, 37%	B	0	
24	Hydrofluoric Acid, 48%	B	2	Gloss change
25	Hydrogen Peroxide, 30%	B	0	
26	Iodine, Tincture of	B	1	Slight gloss change
27	Methyl Ethyl Ketone	A	0	
28	Methylene Chloride	A	0	
29	Monochlorobenzene	A	0	
30	Naphthalene	A	0	
31	Nitric Acid, 20%	B	0	
32	Nitric Acid, 30%	B	0	
33	Nitric Acid, 70%	B	2	Gloss change
34	Phenol, 90%	A	0	
35	Phosphoric Acid, 85%	B	0	
36	Silver Nitrate, Saturated	B	0	
37	Sodium Hydroxide, 10%	B	0	
38	Sodium Hydroxide, 20%	B	0	
39	Sodium Hydroxide, 40%	B	0	
40	Sodium Hydroxide, Flake	B	1	Slight gloss change
41	Sodium Sulfide, Saturated	B	0	
42	Sulfuric Acid, 33%	B	0	
43	Sulfuric Acid 77%	B	0	
44	Sulfuric Acid, 96%	B	2	Gloss change, Color change
45	Sulfuric Acid, (77%) and Nitric Acid (70%), equal parts	B	2	Gloss change
46	Toluene	A	0	
47	Trichloroethylene	A	0	
48	Xylene	A	0	
49	Zinc Chloride, Saturated	B	0	

**Table 4: Max Compact Interior Black Sample Summary Results Table:**

TOTALS			
ITEMS	REQUIREMENT	NO. REAGENT WITH 3 RATINGS	DISPOSITION
Volatile Subtotal:	-	0	---
Non-volatile Subtotal:	-	0	---
Grand Totals:	No More than Four Level 3 Conditions	0	*Conforming

\* Suitability for a given application is dependent upon the chemicals used in a given laboratory.

**Table 5: Max Compact Interior White Sample Chemical Spot Test Results**

TEST NO.	CHEMICAL (% BY VOL.)	METHOD	RATING	COMMENTS
1	Acetate, Amyl	A	0	
2	Acetate, Ethyl	A	0	
3	Acetic Acid, 98%	B	0	
4	Acetone	A	0	
5	Acid Dichromate, 5%	B	0	
6	Alcohol, Butyl	A	0	
7	Alcohol, Ethyl	A	0	
8	Alcohol, Methyl	A	0	
9	Ammonium Hydroxide, 28%	B	0	
10	Benzene	A	0	
11	Carbon Tetrachloride	A	0	
12	Chloroform	A	1	Slight gloss change
13	Chromic Acid, 60%	B	0	
14	Cresol	A	0	
15	Dichloroacetic Acid	A	0	
16	Dimethylformamide	A	0	
17	Dioxane	A	0	
18	Ethyl Ether	A	0	
19	Formaldehyde, 37%	A	0	
20	Formic Acid, 90%	B	0	
21	Furfural	A	2	Staining
22	Gasoline	A	0	
23	Hydrochloric Acid, 37%	B	0	
24	Hydrofluoric Acid, 48%	B	1	Slight gloss change
25	Hydrogen Peroxide, 30%	B	0	
26	Iodine, Tincture of	B	1	Slight staining
27	Methyl Ethyl Ketone	A	0	
28	Methylene Chloride	A	0	
29	Monochlorobenzene	A	0	
30	Naphthalene	A	0	
31	Nitric Acid, 20%	B	0	
32	Nitric Acid, 30%	B	0	
33	Nitric Acid, 70%	B	1	Slight gloss change
34	Phenol, 90%	A	0	
35	Phosphoric Acid, 85%	B	0	
36	Silver Nitrate, Saturated	B	2	Staining, color change
37	Sodium Hydroxide, 10%	B	2	Color change





TEST NO.	CHEMICAL (% BY VOL.)	METHOD	RATING	COMMENTS
38	Sodium Hydroxide, 20%	B	2	Color change
39	Sodium Hydroxide, 40%	B	1	Slight color change
40	Sodium Hydroxide, Flake	B	0	
41	Sodium Sulfide, Saturated	B	0	
42	Sulfuric Acid, 33%	B	0	
43	Sulfuric Acid 77%	B	0	
44	Sulfuric Acid, 96%	B	1	Slight gloss change
45	Sulfuric Acid, (77%) and Nitric Acid (70%), equal parts	B	2	Color change
46	Toluene	A	0	
47	Trichloroethylene	A	0	
48	Xylene	A	0	
49	Zinc Chloride, Saturated	B	0	

**Table 6: Max Compact Interior White Sample Summary Results Table:**


TOTALS			
ITEMS	REQUIREMENT	NO. REAGENT WITH 3 RATINGS	DISPOSITION
Volatile Subtotal:	-	0	---
Non-volatile Subtotal:	-	0	---
Grand Totals:	No More than Four Level 3 Conditions	0	*Conforming

\* Suitability for a given application is dependent upon the chemicals used in a given laboratory.

**PHOTOGRAPHS:**

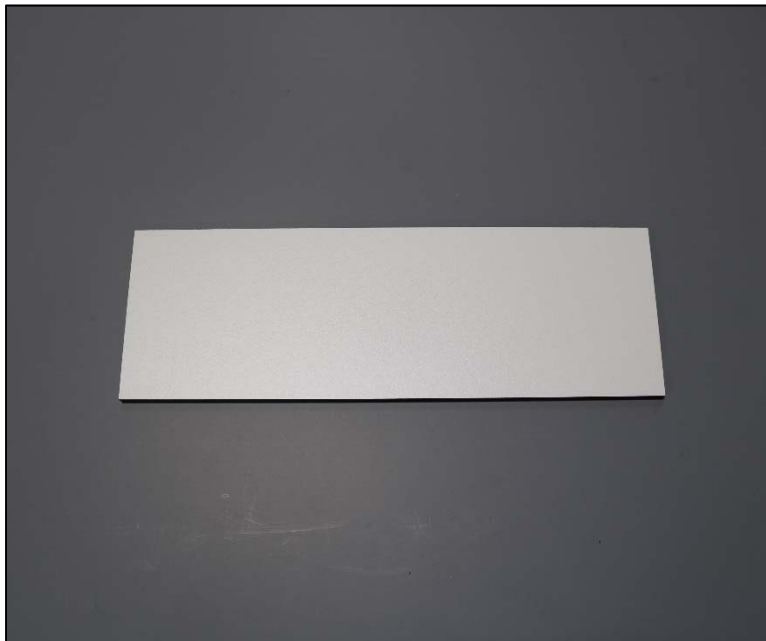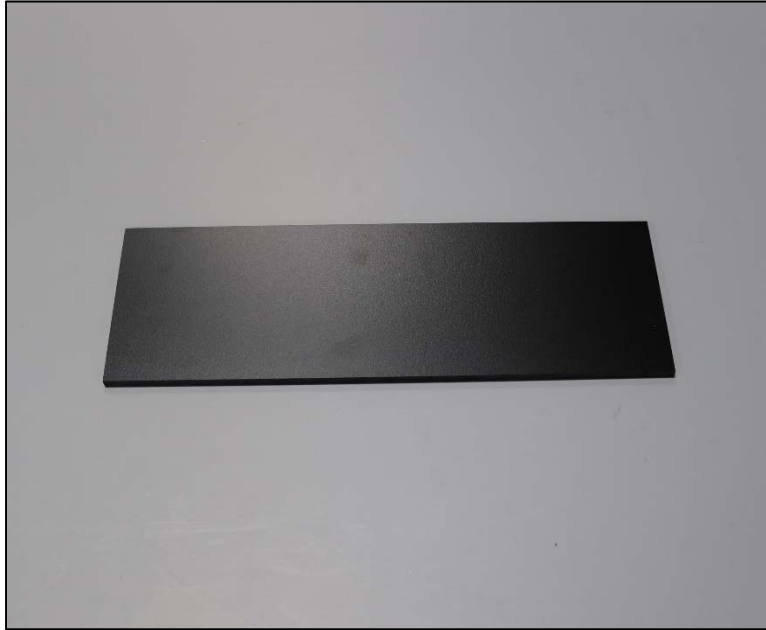


**Chemical Spot Test "As Received" Test Panels**

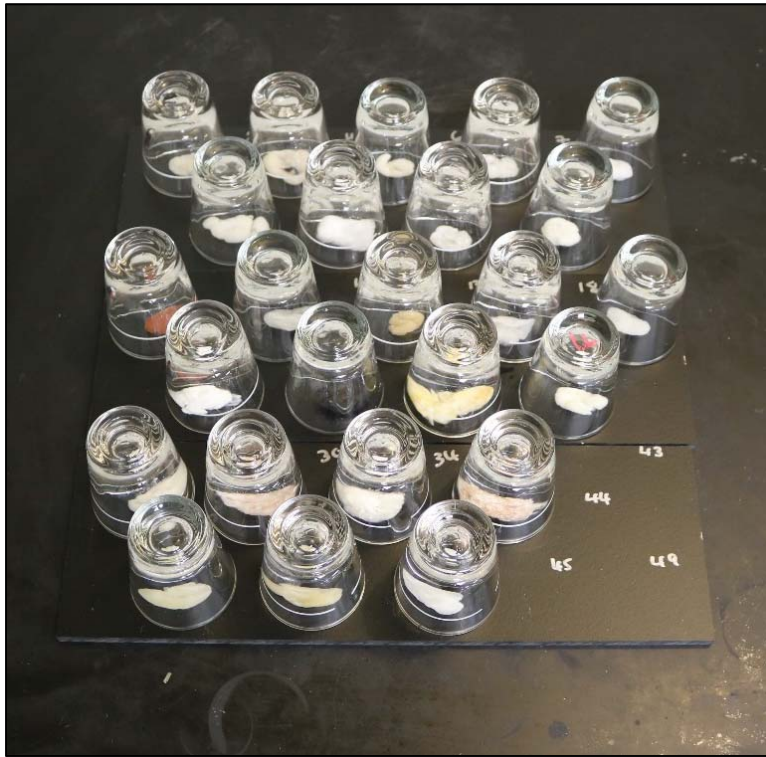


Representative Chemical Spot Test Volatile Chemical Set-up




Representative Chemical Spot Test Non-volatile Chemical Set-up

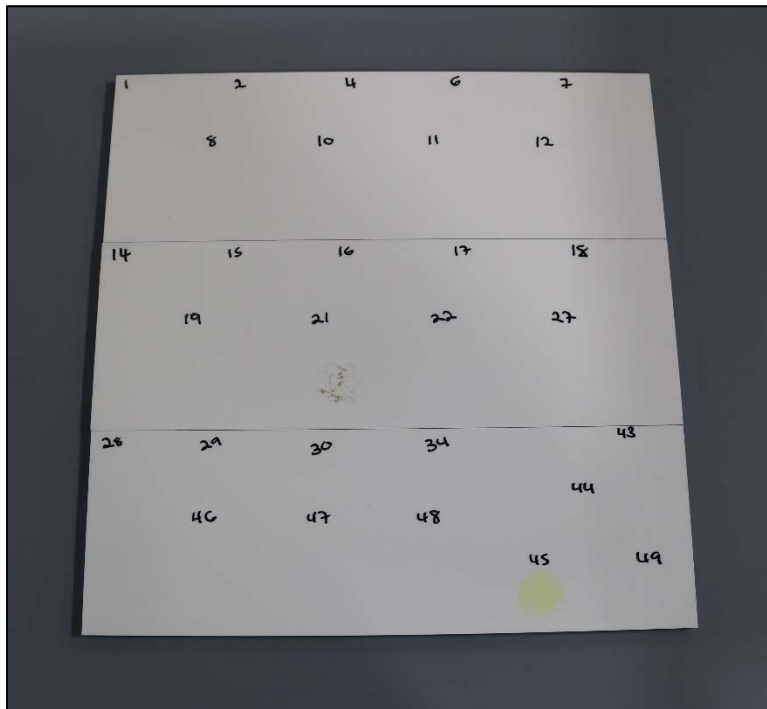


Chemical Spot Test Volatile after Exposure, White Sample

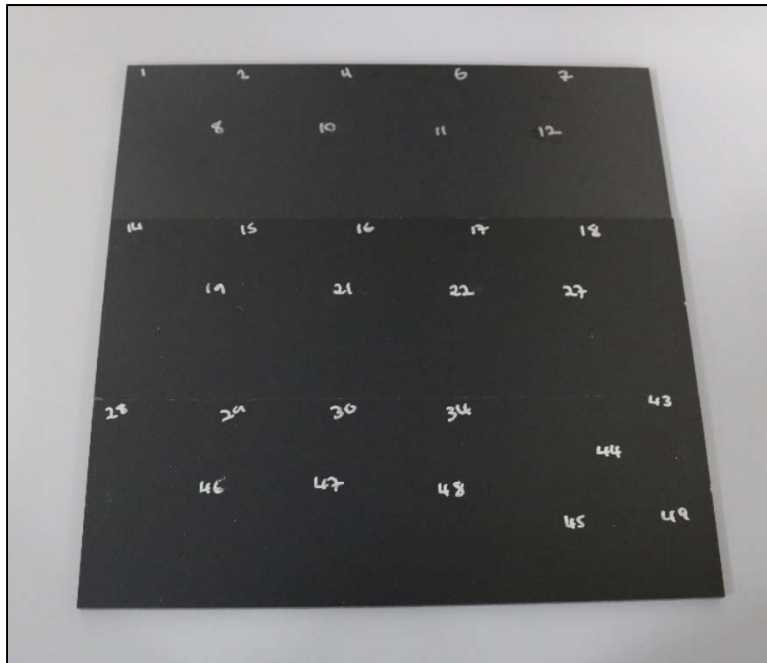

Chemical Spot Test Volatile after Exposure, Black Sample

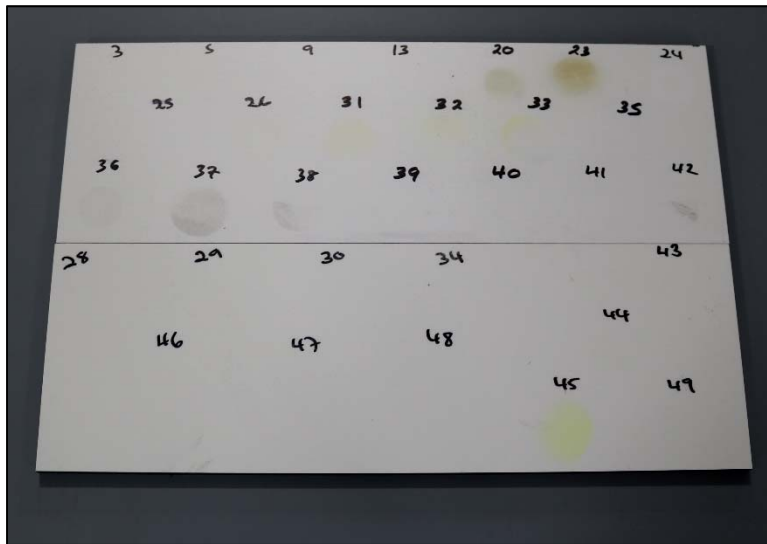

Chemical Spot Test Non-volatile after Exposure, White Sample

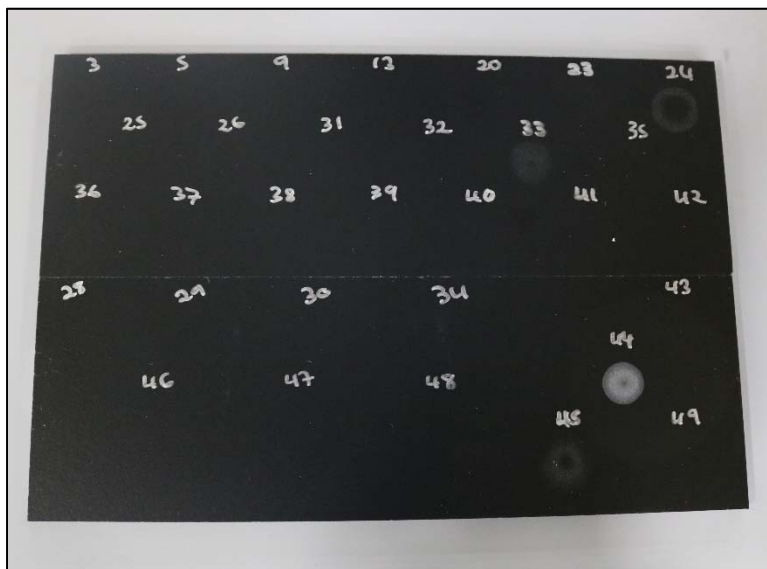


Chemical Spot Test Non-volatile after Exposure, Black Sample



**Chemical spot test #24, Hydrofluoric Acid (48%), Rating 2, Gloss change**



**Chemical spot test #33, Nitric Acid (70%), Rating 2, Gloss change**

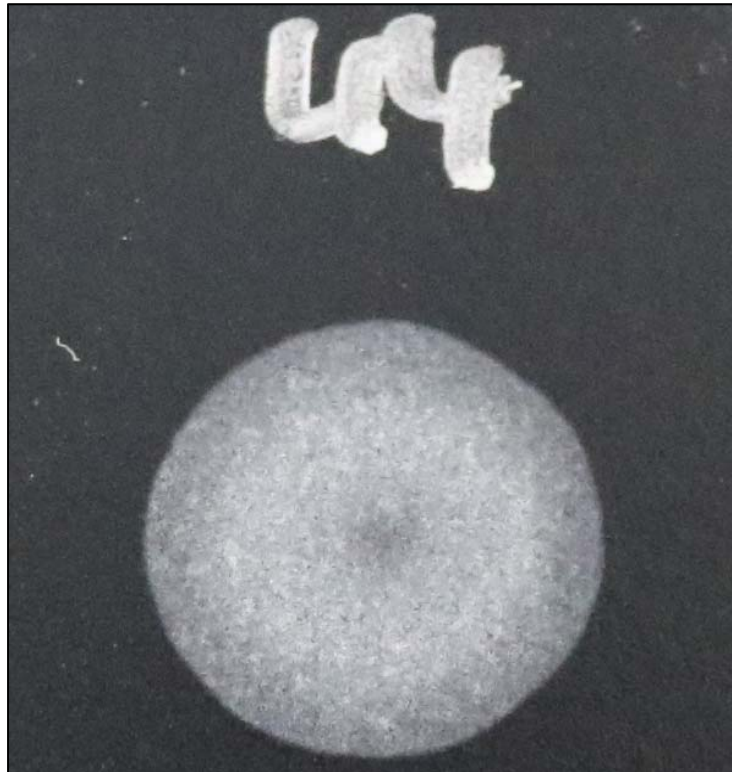


**Chemical spot test #44, Sulfuric Acid (96%), Rating 2, Gloss change, Color change**



**Chemical spot test #45, Sulfuric Acid (77%) and Nitric Acid (70%), equal parts, Rating 2, Gloss change**




**Chemical Spot Test #21, Furfural, Rating 2, Staining**

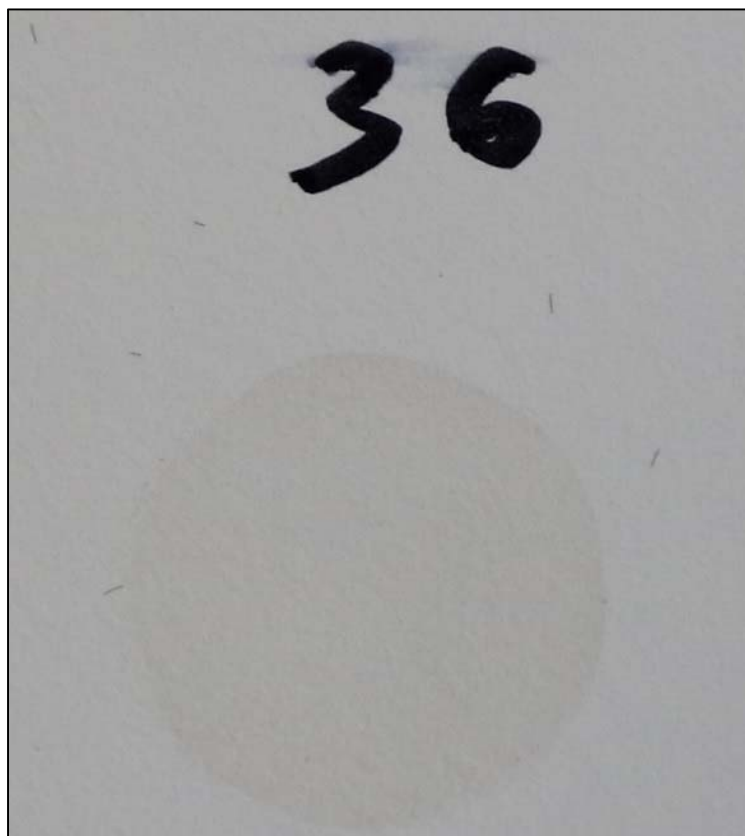

**Chemical spot test #36, Silver Nitrate, Saturated, Rating 2, Staining**




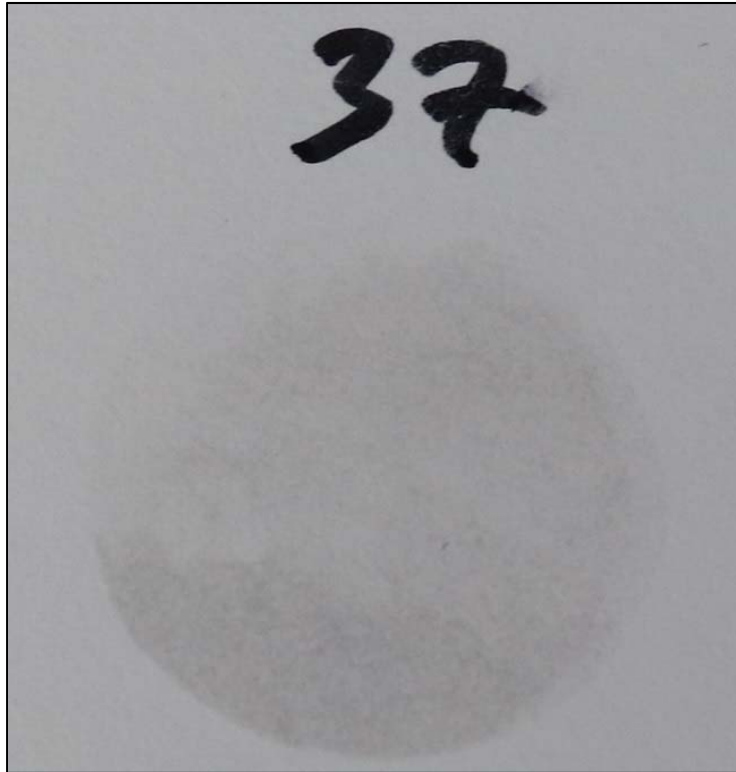

**Chemical spot test #37, Sodium Hydroxide (10%), Rating 2, Color change**



**Chemical spot test #38, Sodium Hydroxide (20%), Rating 2, Color change**

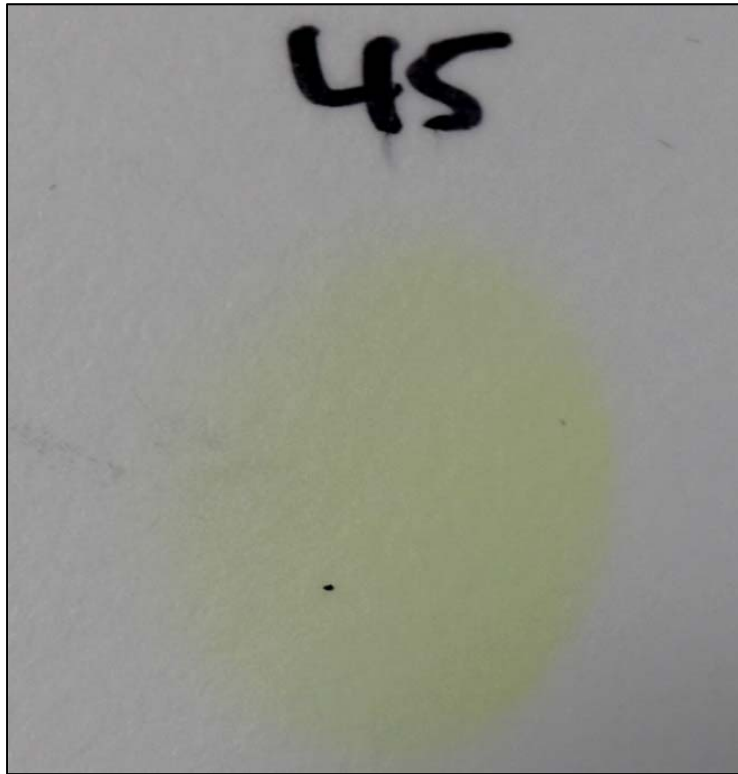

**Chemical spot test #45, Sulfuric Acid (77%) and Nitric Acid (70%), equal parts, Rating 2, color change**